

Errata to
ASHRAE Design Guide for Tall, Supertall, and Megatall Building Systems
(2015)


May 9, 2016


Shaded items have been added since the previously published errata sheet dated February 11, 2016.

Page xvii: In the list of experts, “Mark Donattel, Thornton Tomasetti, Los Angeles” should read “Mark **Dannettel**, Thornton **Thomasseti**, Los Angeles.”

Pages 144 and 177: Figures 12.1 and 15.1 should be switched. The captions should stay the same. These figures should appear as shown on the following pages.


Page 16: Figure 2.9 should appear as shown below:

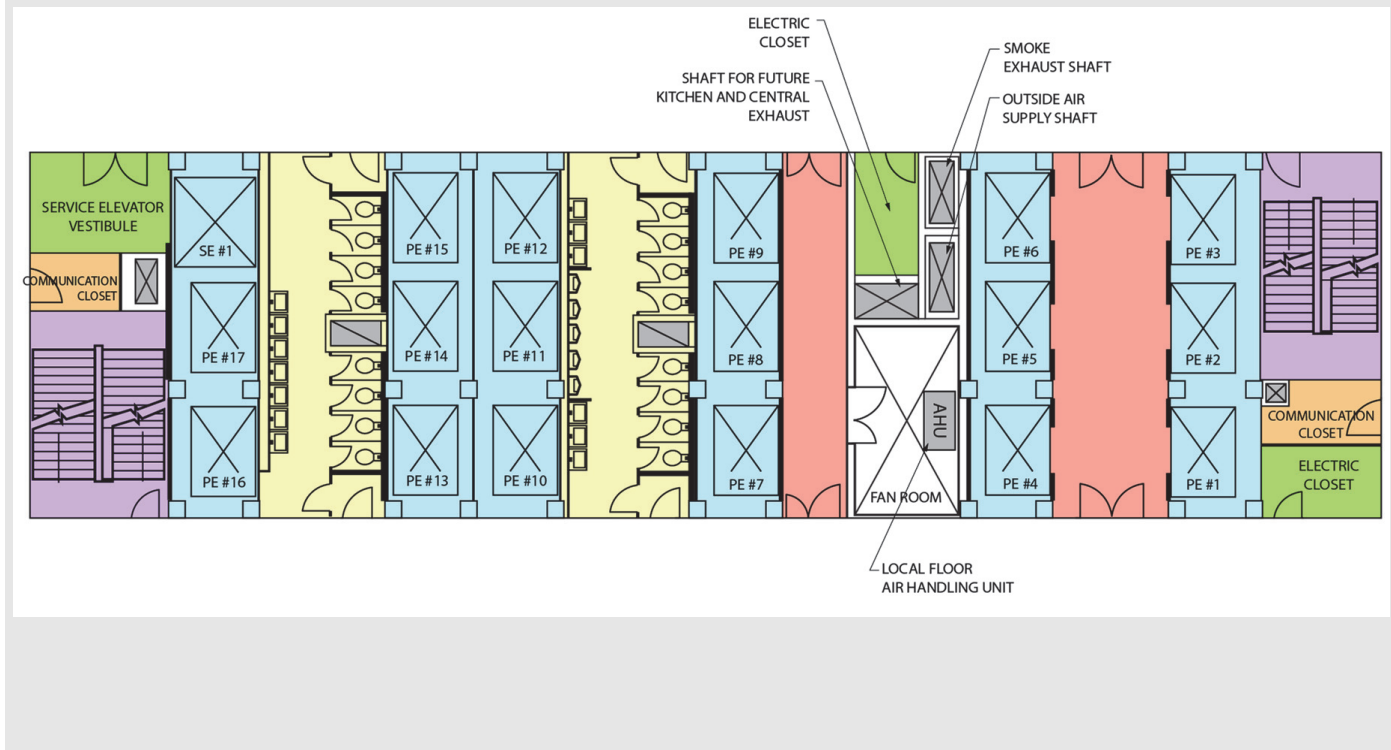

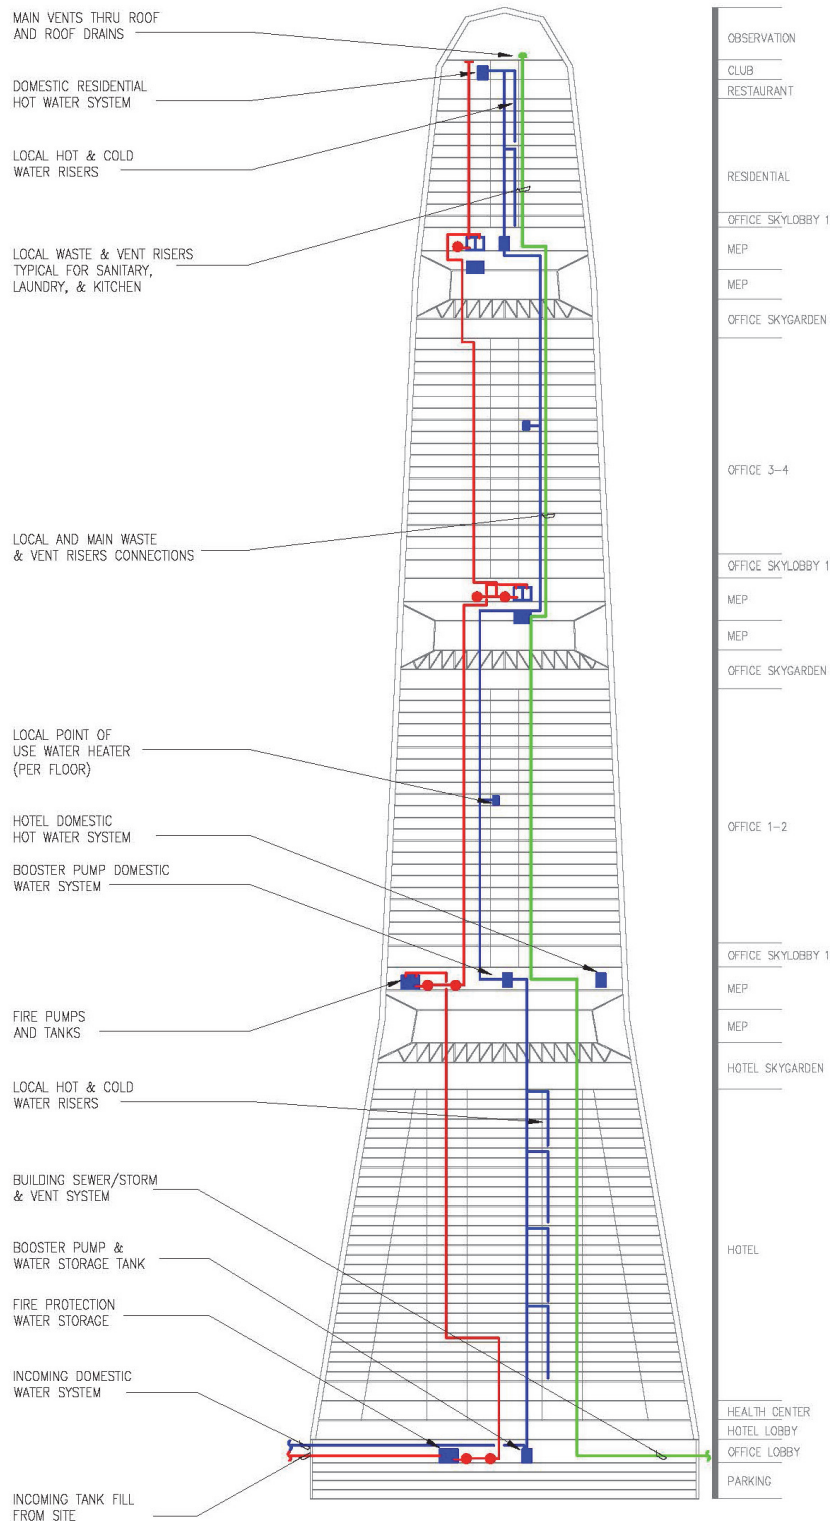

PLUMBING / FIRE PROTECTION

Figure 12.1 A typical water distribution for a megatall building.

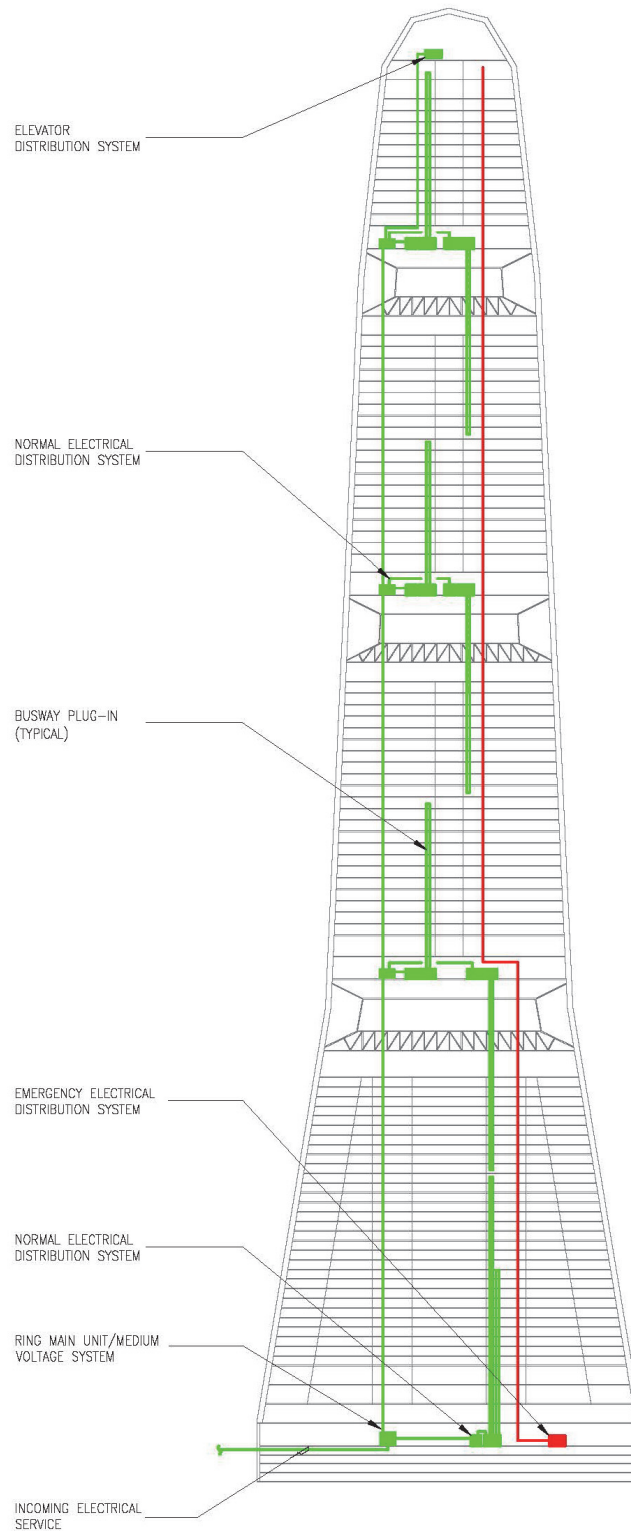

ELECTRICAL

Figure 15.1 A typical electrical distribution for a megatall building.